


Greyter HOME Connections

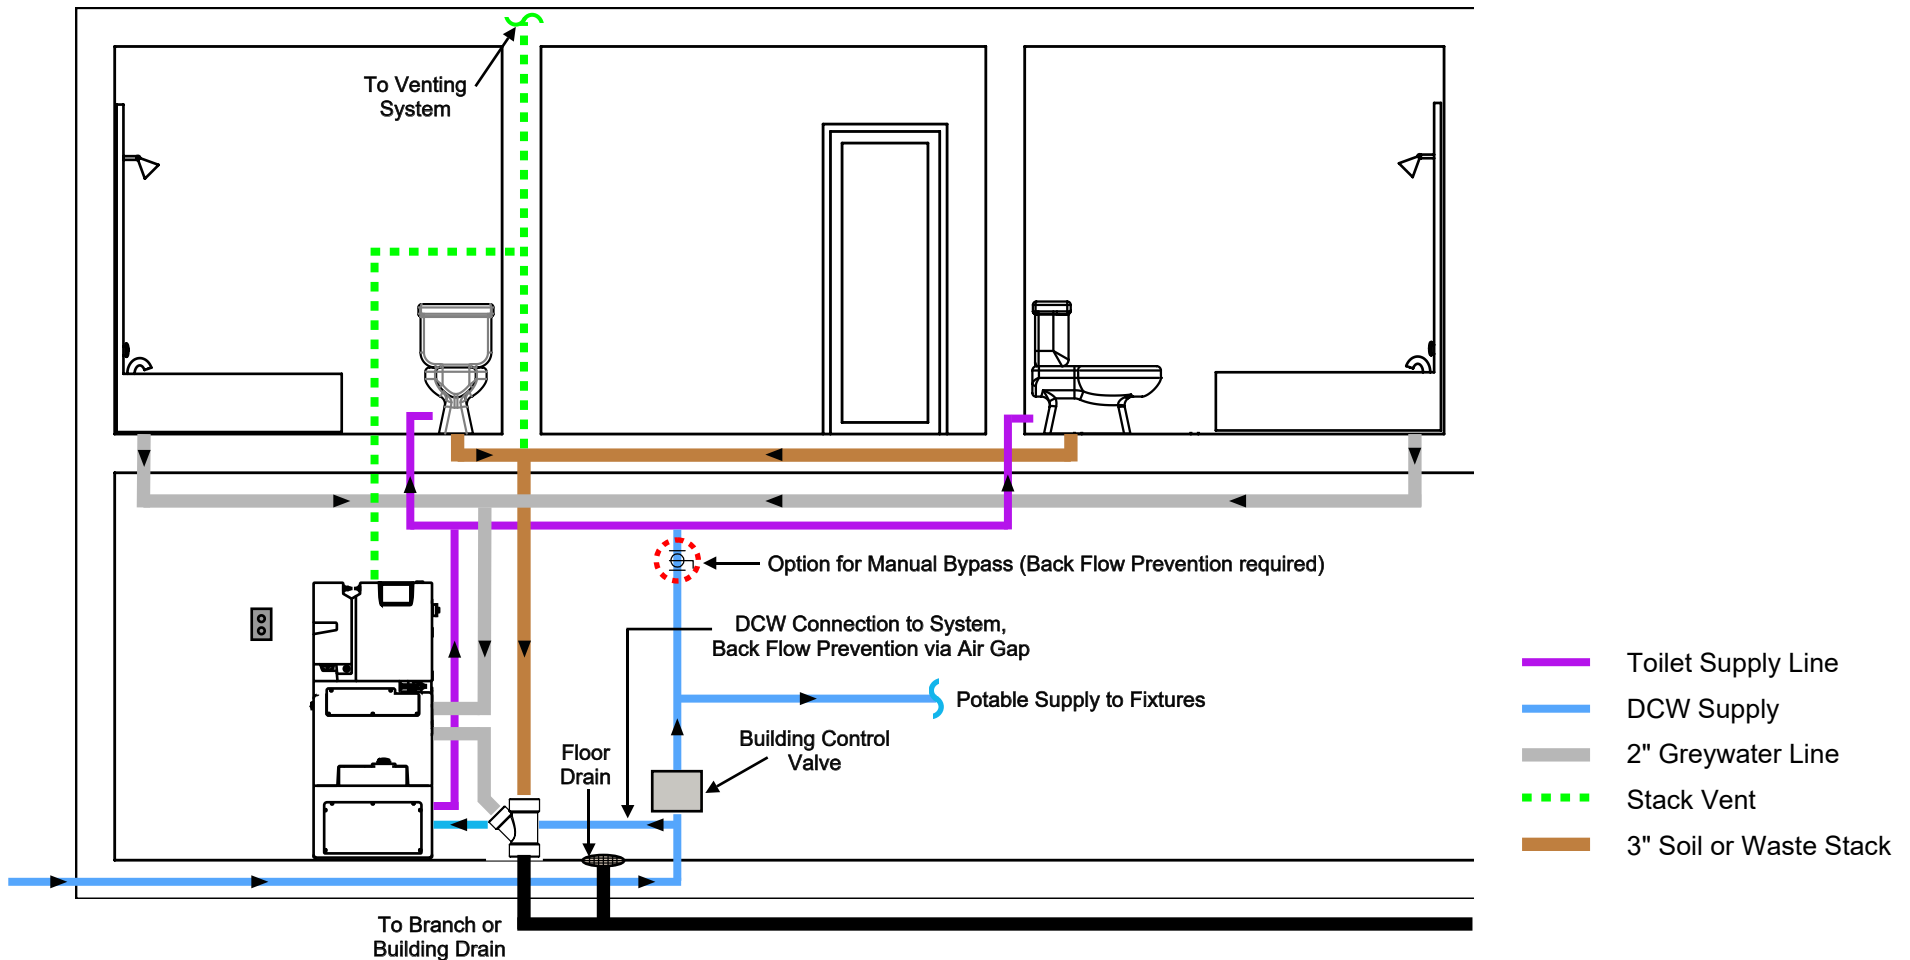

1. Isolate greywater - Minimum 2 showers (2")
2. Homerun greywater to Greyter HOME
3. If overflow is tying into a 3" soil or waste stack, connection is a 3" x 4" cleanout with 2" side fitting. If tying into a 2" soil or waste stack, connection is a 2" x 2" cleanout with 2" side fitting. Fitting to to be tight to the slab.
4. Isolate supply lines to toilets (purple pipe or use marking tape with non potable writing)
5. Vent Greyter HOME (1.5" or 2")
6. Provide single gang 15 Amp (dedicated), 120V. Plug should be 60" above finished floor within 12" of unit
7. Provide floor drain within 24" of the Greyter HOME