


Commercial In-Duct UV Air Purification Intake Requirements

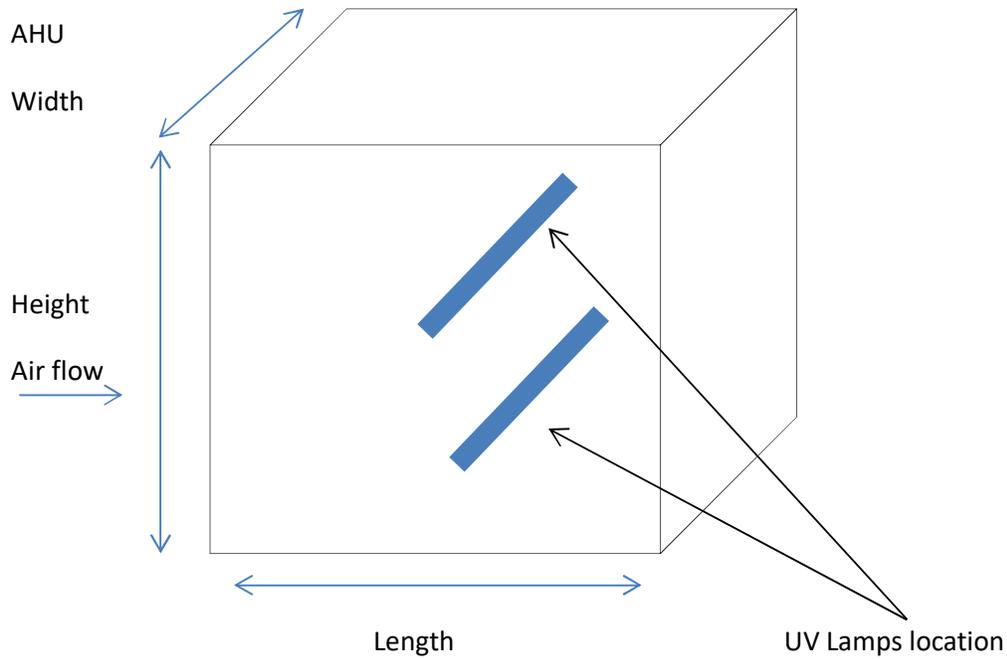

Please provide the width, height and length of the Air Handler Unit (AHU) and the CFM of air flow in order to specify the correct UV unit.

Width:

Height:

Length:

CFM Air Flow:

Please return to Eco-Smart, Inc. by email: info@eco-smart.com